


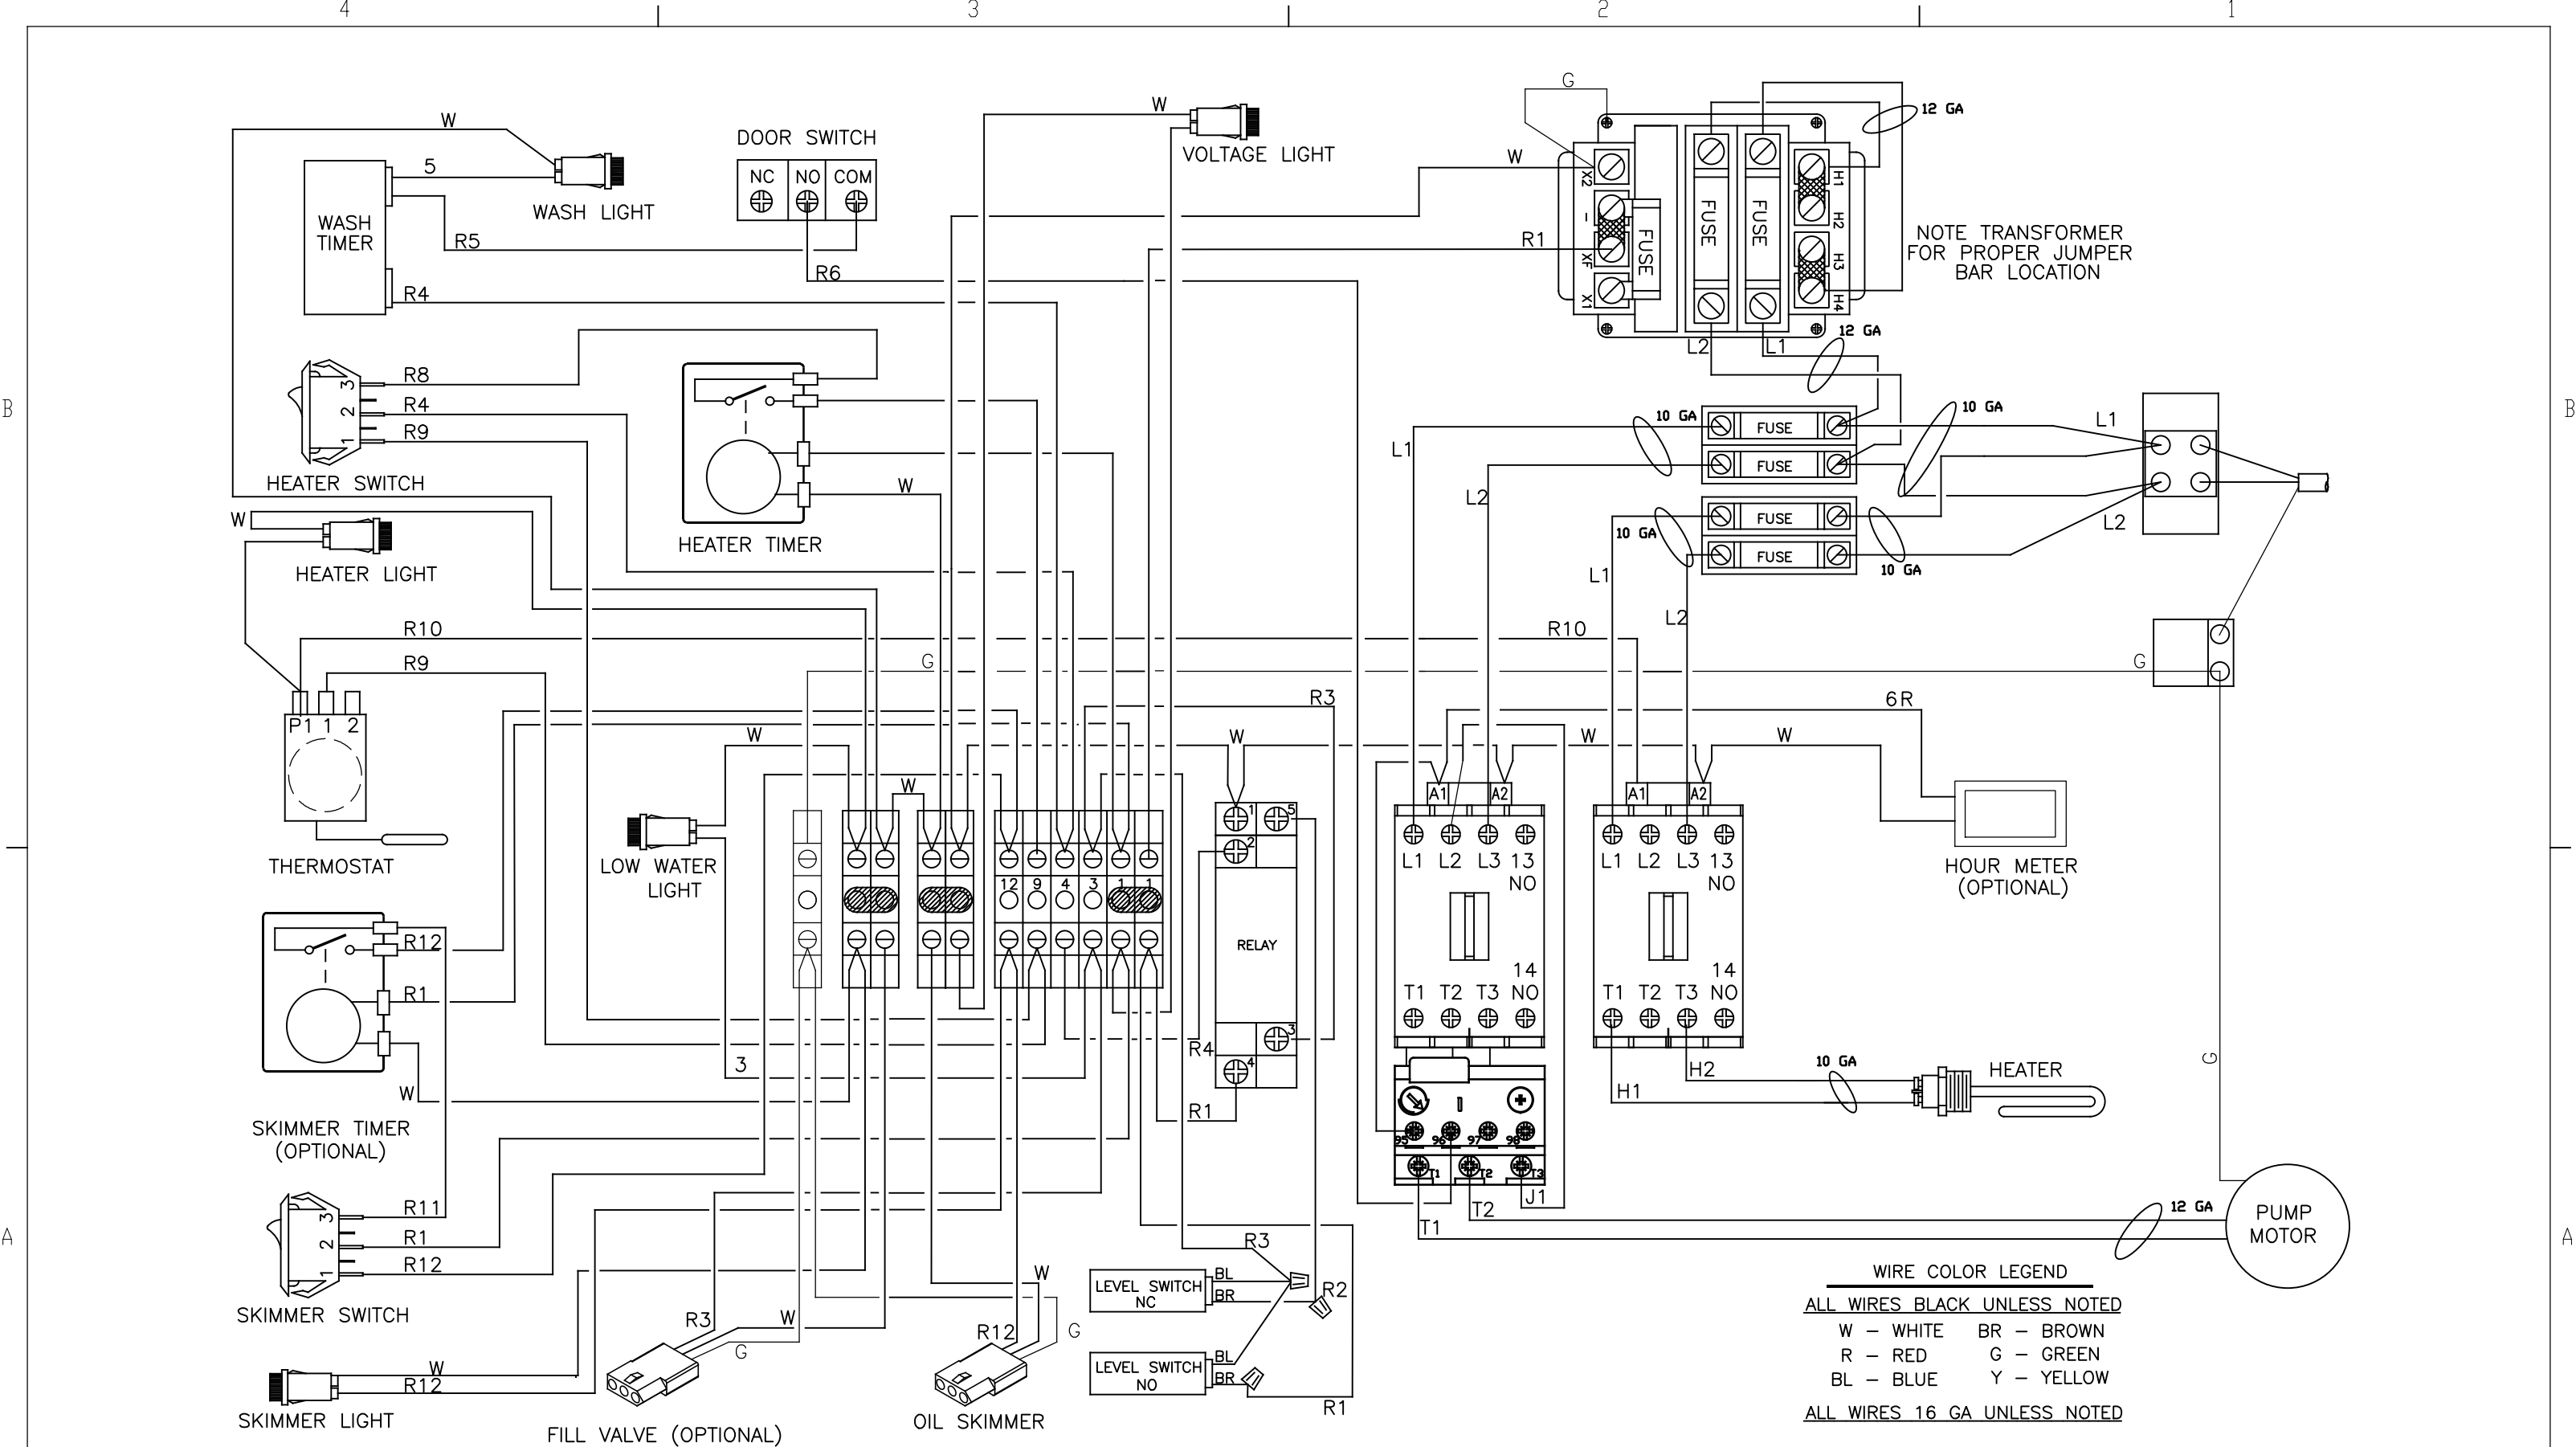

REV.	ECN	DESCRIPTION	DATE	APPROVED
A	5017810	UPDATED RELAY TO CURRENT	2/4/2013	DLA
B	5023550	REROUTE ZONE C1 WIRES FROM TERMINAL BLOCK TO FUSE BLOCK. MAX 2 WIRES PER TERMINAL	2/20/2015	DLA
C	5023858	ADDED OVERLOAD	4/18/2015	DLA
D	5027751	ADDED OUTPUT VOLTAGE ON TRANSFORMER, FIXED WIRING ON OVERLOAD	9/26/2016	DLA
E	5028615	CHANGE AWG FROM 8 TO 10 FOR 6KW HEATING ELEMENTS	2/15/2017	DLA
F	5030351	CHANGED WIRE NUMBERS/COLORS AND REROUTED WIRES	11/17/2017	DLA
G	1028	CUDA TITLE BLOCK, UPDATED WIRE NUMBERS, REMOVED CONNECTOR	12/10/2022	KAK

TITLE: WIRING DIAGRAM, 208/230V 1PH, SJ-15					
 CUDA CLEANING SYSTEMS PROPRIETARY AND CONFIDENTIAL THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF CUDA CLEANING SYSTEMS. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF CUDA CLEANING SYSTEMS IS PROHIBITED.	600 21st ST SW WATERTOWN, SD 57201		SIZE	DWG. NO.	REV
	DRAWN BY: KAK		B	9.807-587.0	G
	ENG APPR. KAK		DATE: 9/15/2023 2:55: PM		SHEET 1 OF 1