


B

B


A

A

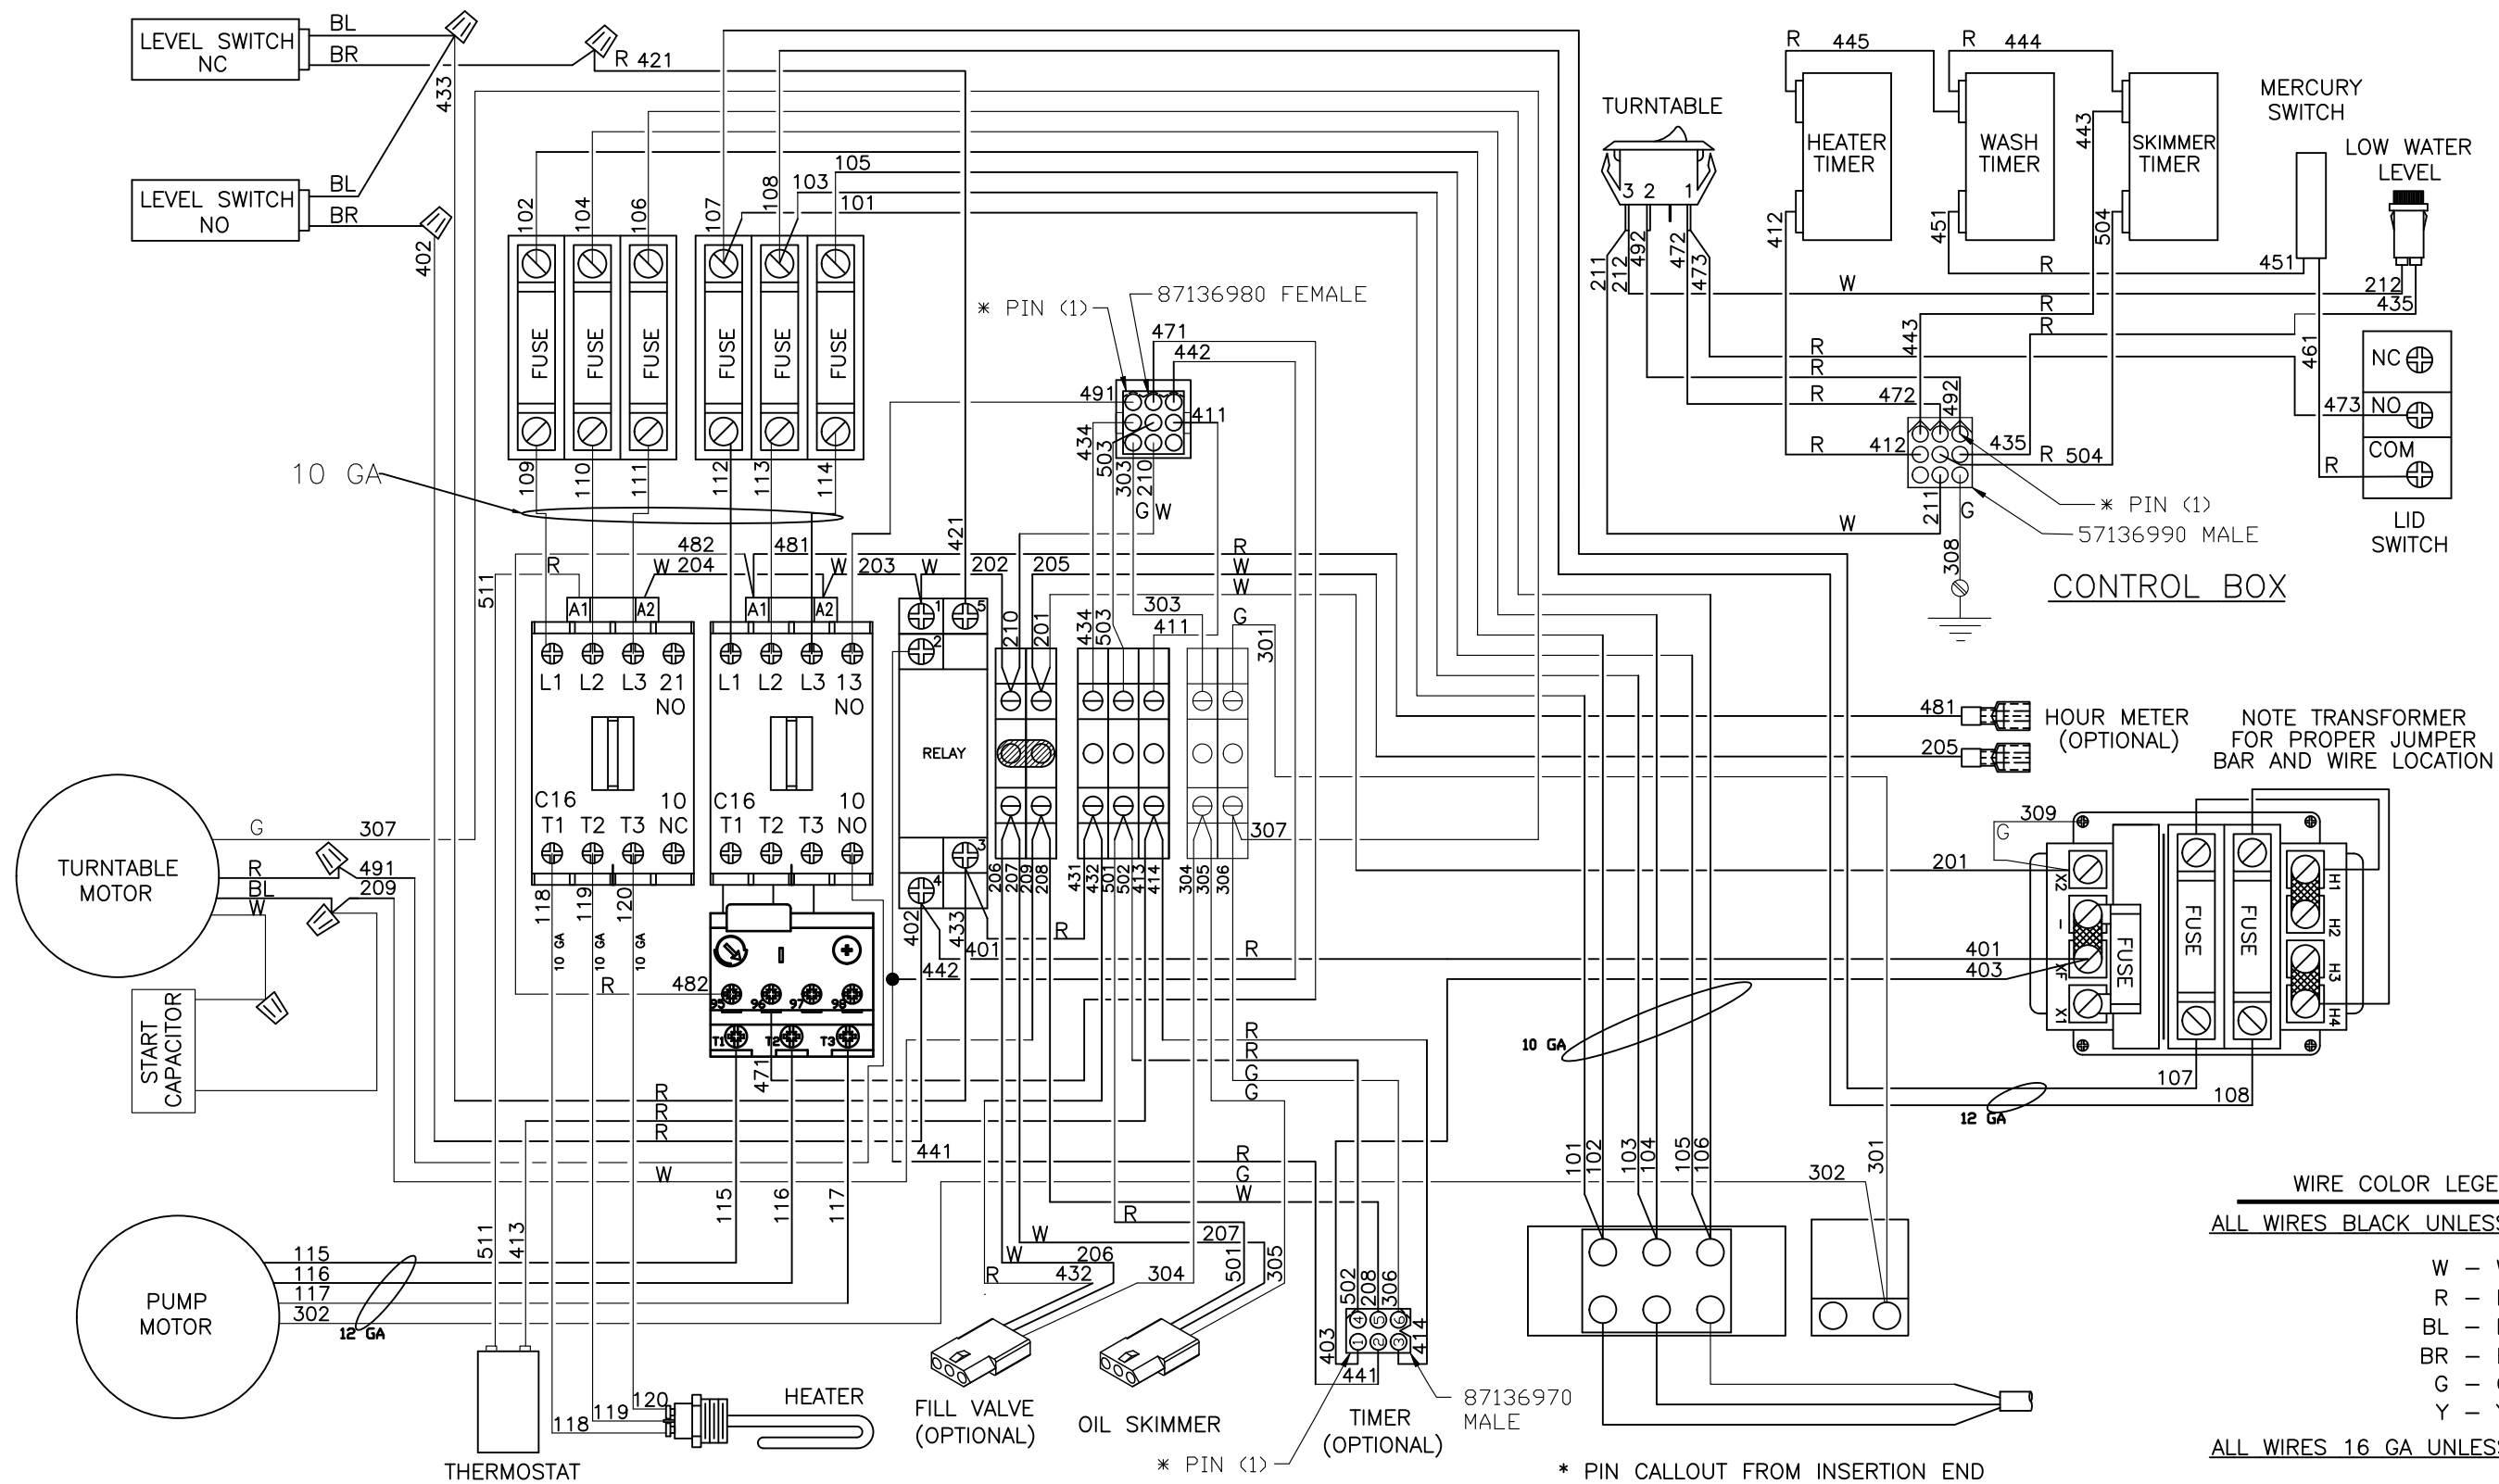

| REV. | ECN     | DESCRIPTION                                                                       | DATE      | APPROVED |
|------|---------|-----------------------------------------------------------------------------------|-----------|----------|
| 5    |         | CHANGE CONTACTOR DETAILS                                                          | 1/16/2008 |          |
| A    | 5017812 | UPDATED RELAY TO CURRENT                                                          | 2/4/2013  | DLA      |
| B    | 5022259 | CHANGED TURNTABLE WIRING AND CHANGES MISC NOTES                                   | 7/24/2014 | DLA      |
| C    | 5023539 | REROUTE ZONE B3 WIRES FROM TERMINAL BLOCK TO FUSE BLOCK. MAX 2 WIRES PER TERMINAL | 2/20/2015 | DLA      |
| D    | 5029293 | ADDED NUMBERED WIRE CALLOUTS                                                      | 6/2/2017  | DLA      |
| E    | 5029522 | CHANGED WIRE CALLOUT STYLE, FIXED WIRE LOCATIONS                                  | 7/13/2017 | DLA      |
| F    | 5030822 | CHANGED WIRE NUMBERS TO NEW SCHEME                                                | 2/23/2018 | DLA      |
| G    | 1168    | REROUTE WIRE 491                                                                  | 10/2/2023 | KAK      |

TITLE: WIRING DIAGRAM, 230/460/575V 3PH

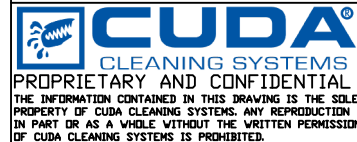600 21st ST SW  
WATERTOWN, SD 57201

DRAWN BY:

JCK

ENG APPR.

KAK

SIZE

DWG. NO.

REV

B

9.807-589.0

G

DATE: 10/2/2023 6:22: PM

SHEET 1 OF 1